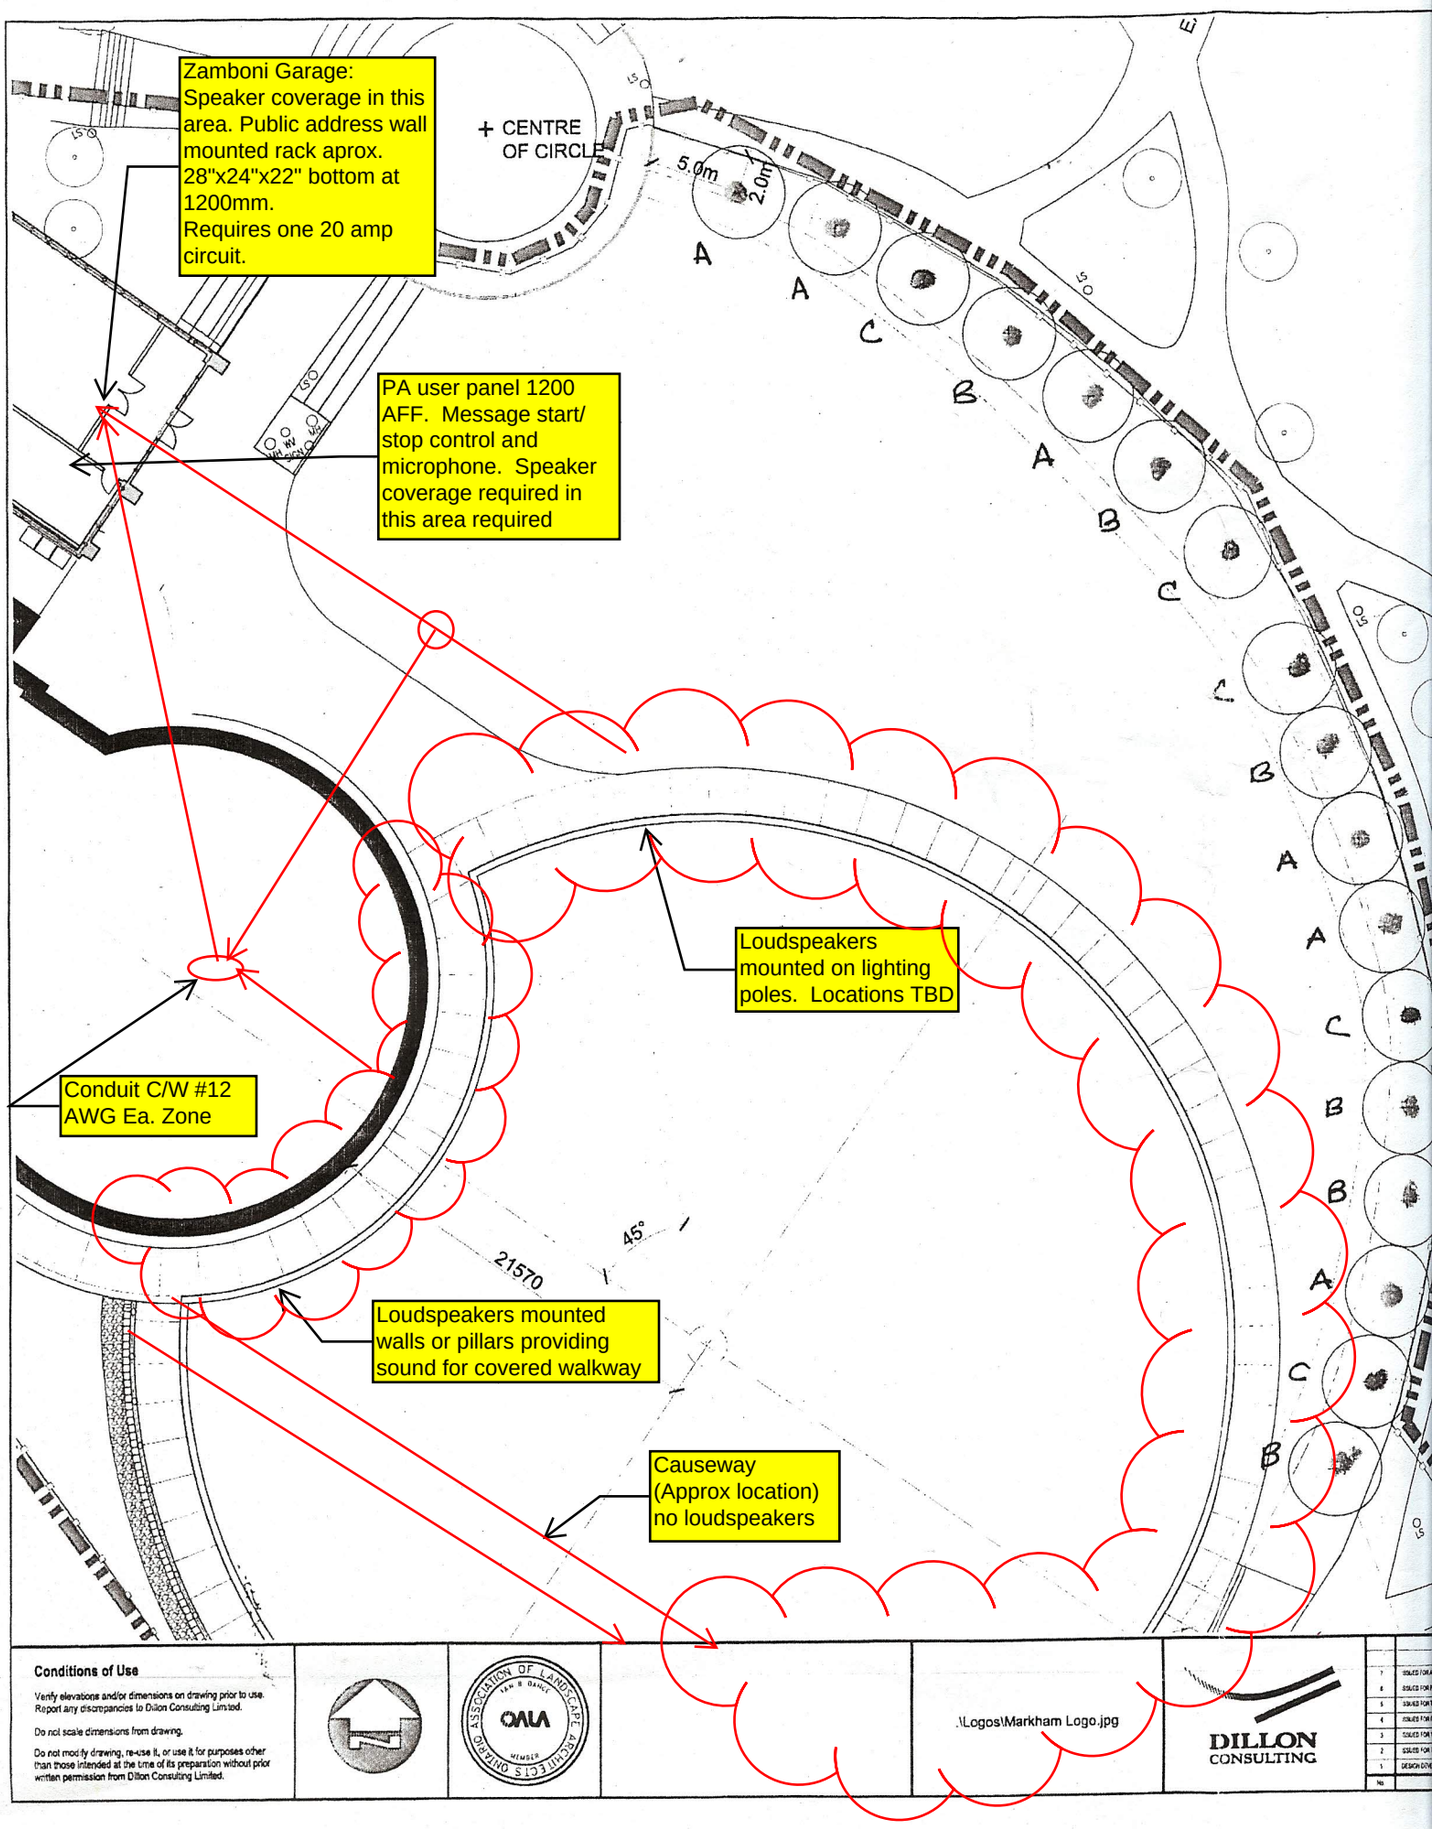
Zamboni Garage: Speaker coverage in this area. Public address wall mounted rack aprox. 28"x24"x22" bottom at 1200mm. Requires one 20 amp circuit.
+ CENTRE OF CIRCLE
5.0m
2.0m
PA user panel 1200 AFF. Message start/ stop control and microphone. Speaker coverage required in this area required
Loudspeakers mounted on lighting poles. Locations TBD
Conduit C/W #12 AWG Ea. Zone
45°
21570
Loudspeakers mounted walls or pillars providing sound for covered walkway
Causeway (Approx location) no loudspeakers
Conditions of Use
Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.
Do not scale dimensions from drawing.
Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.
\Logos\Markham Logo.jpg
DILLON CONSULTING